



- NOTES:**
1. TEST GROUND PRIOR TO INSTALLATION OF GROUND ROD TO DETERMINE SOIL RESISTIVITY.
  2. REFER TO GROUNDING NOTES FOR REQUIREMENTS.

**GROUND ROD INSTALLATION DETAIL**  
NOT TO SCALE

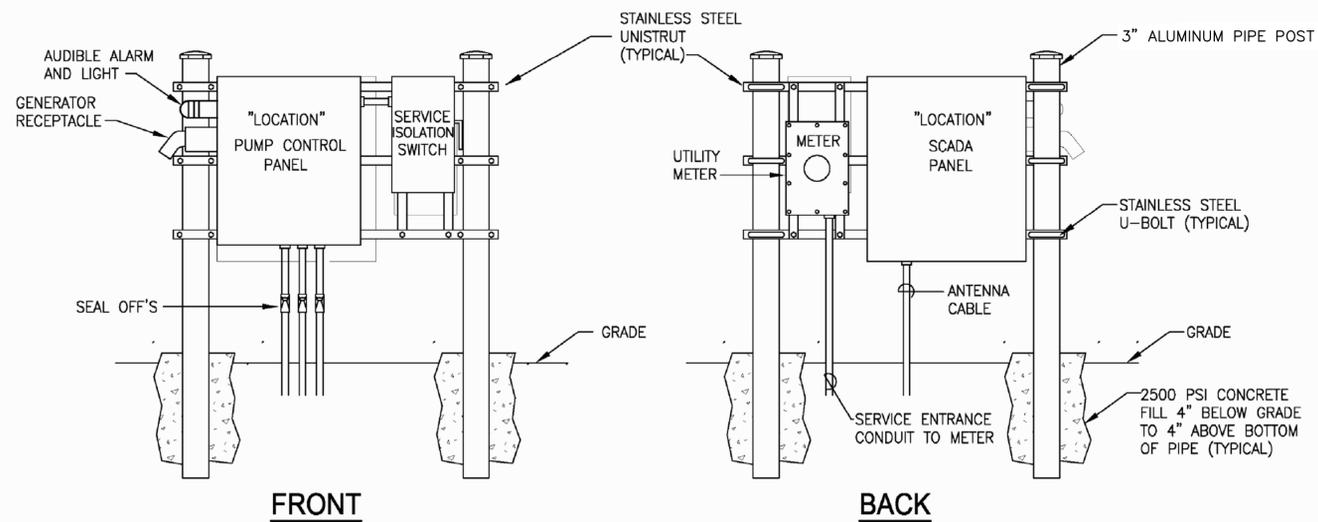

**TYPICAL ELECTRIC EQUIPMENT MOUNTING DETAIL**  
NOT TO SCALE

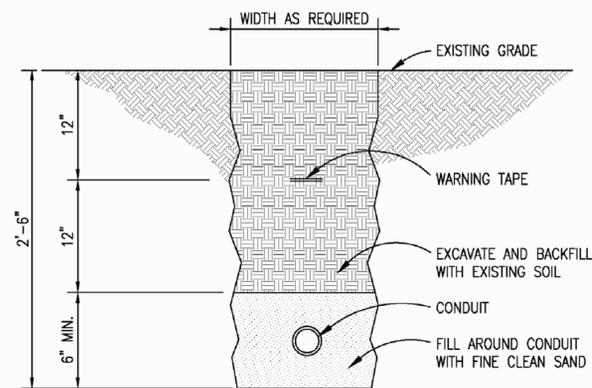

THE CONTRACTOR SHALL, AT A MINIMUM, UTILIZE NPDES EROSION AND SEDIMENT CONTROL METHODS.

**DIRECT BURIED CONDUIT DETAIL**  
NOT TO SCALE

**ELECTRICAL NOTES:**

- ① CONTRACTOR SHALL APPLY FOR PERMIT FROM ORMOND BEACH BUILDING DEPARTMENT FOR EACH PUMP STATION SITE.
- ② SPD SHALL BE LEVITON #57120-M3 OR APPROVED EQUAL.
- ③ ALARM LIGHT AND AUDIBLE ALARM SHALL BE INSTALLED ON THE PUMP CONTROL PANEL USING A WEATHER TIGHT CONNECTION. ALARM LIGHT SHALL BE RUSSELL STOLL TYPE VLP CATALOG # 6345A. AUDIBLE ALARM SHALL BE FEDERAL SIGNAL MODEL # 350 OR APPROVED EQUAL.
- ④ REQUIREMENTS FOR PUMP CONTROL AND SCADA PANELS ARE NOTED ON ORMOND BEACH STANDARD DETAILS AS INCLUDED IN THIS DRAWING SET.
- ⑤ SEAL-OFFS SHALL BE FILLED USING CHICO FIBER.