


ACCEPTABLE MANUFACTURERS:
 WILKINS MODEL 420XL OR APPROVED EQUAL



- NOTE:
- FIELD ADJUST AND CUT ITEM 4 TO THE PROPER LENGTH.
 - NO GALVANIZED FITTINGS OR PIPE ALLOWED.
 - A COPY OF THE ASSEMBLY CERTIFICATION SHALL BE SUBMITTED TO THE CITY'S ENGINEERING DEPARTMENT BEFORE FINAL INSPECTION.
 - ASSEMBLY SHOULD HAVE ADEQUATE LANDSCAPING AROUND IT TO OBSCURE VIEW.
 - ASSEMBLY SHALL BE PAINTED FOREST GREEN

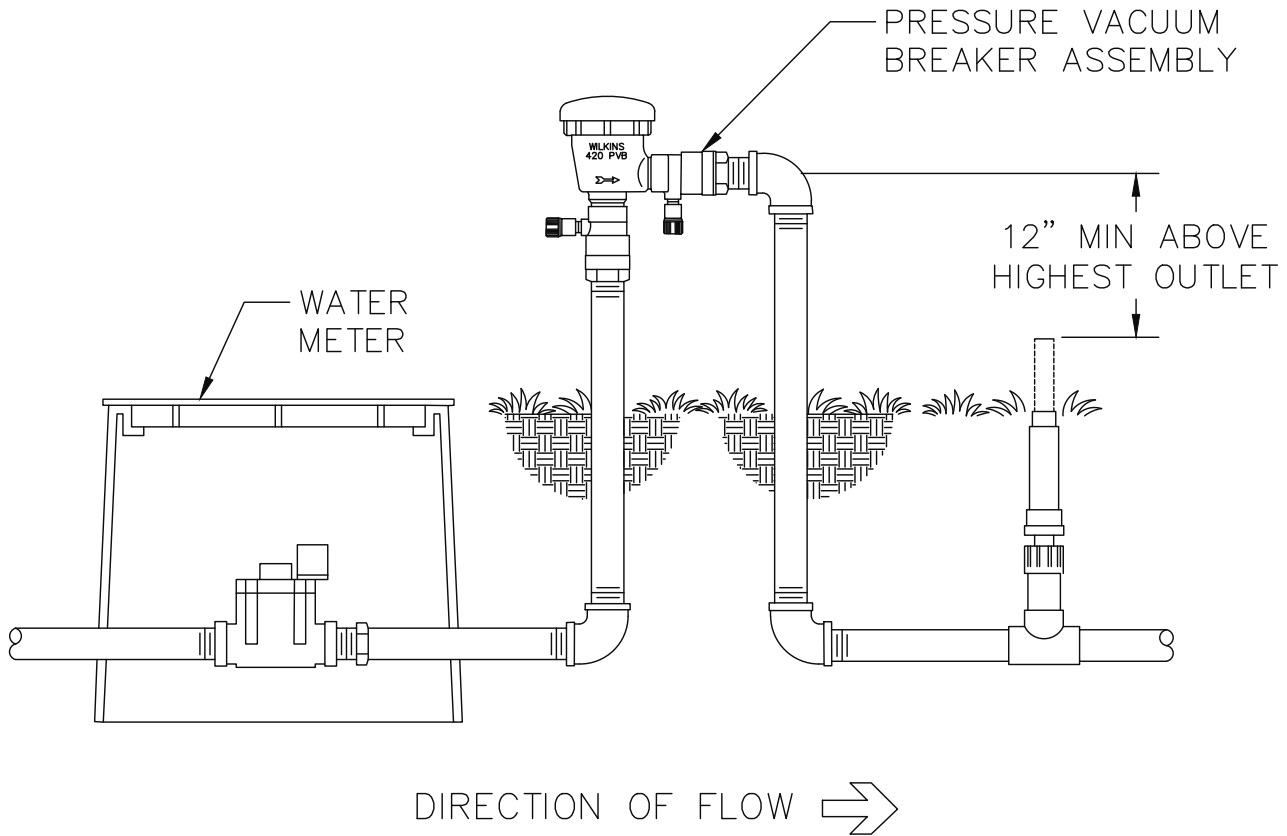

STANDARD CONSTRUCTION DETAIL
PRESSURE VACUUM BREAKER ASSEMBLY
BACKFLOW PREVENTER (RESIDENTIAL
IRRIGATION ONLY) - 3/4" OR 1"

NTS

INDEX

W-6F

MAR 2021